




## CHULA VISTA FIRE DEPARTMENT

FIRE PREVENTION DIVISION


### Multi-Family Sprinkler Connection (FDC\*) Detail

\*FDC's located on the building must have prior approval from the Fire Marshal.

#### Detail A - Sign Only

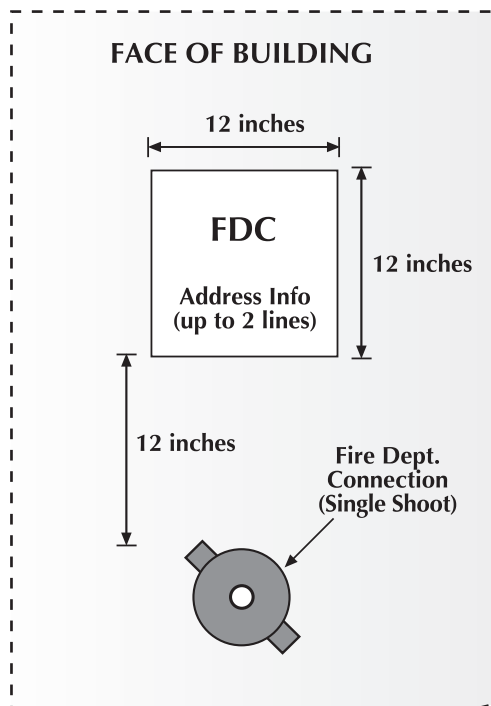

#### Detail B - Sign and Building

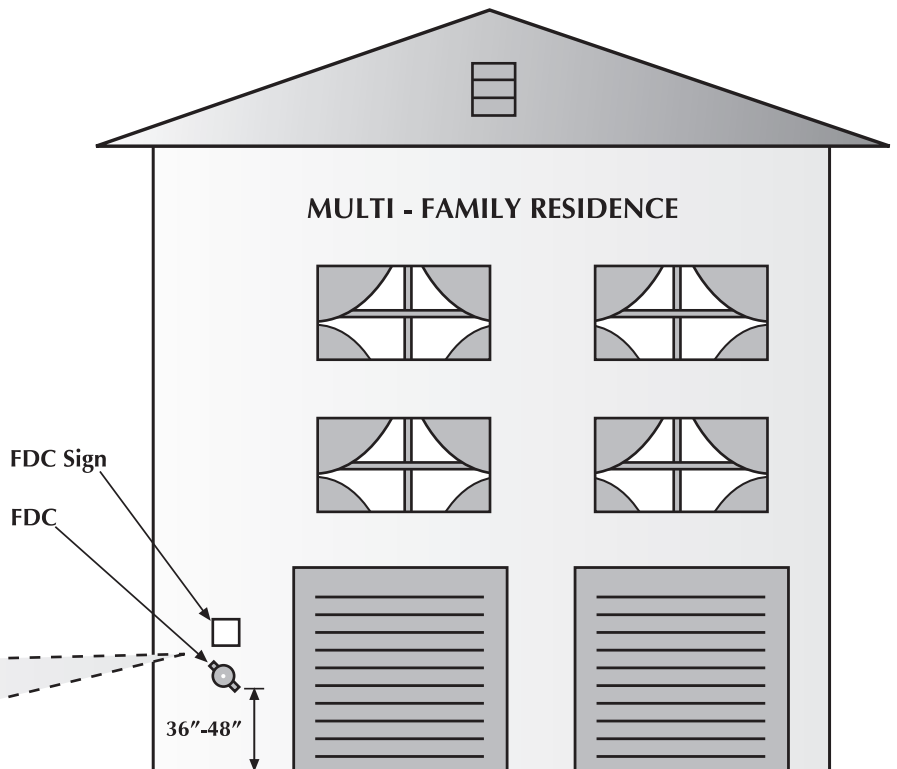

### Sign Specifications

1. Measurements **MUST** be exact and will be subject to a field inspection.
2. Sign must be .080 gauge aluminum.
3. Sign must be diamond grade.
4. Protective 1160 overlay film on sign.
5. Signage letter height:
  - FDC = 3 inches tall and Address = 1 1/4 inches tall
6. Sign must be permanently attached to the building (12 inches) above the FDC.
7. Hole and radii to conform with the State of California specifications.

